

APPENDIX S-13

Variance from Pollution Control

Hawaii Department of Health Wastewater Branch

Permit Packet Includes:

1. Process Overview
2. Application for Variance (Effective December 9, 2004)
3. Hawaii Revised Statutes 342D-7
4. Hawaii Administrative Rules 11-62

Approval or Permit Required: To discharge water pollutant in excess of applicable standards according to Hawaii Administrative Rules 11-62.

Contact Information: 919 Ala Moana Blvd, Room 309
Honolulu, HI 96814-4920
Phone: 808-586-4294
Fax: 808-586-4300


Website: <http://hawaii.gov/health/environmental/water/wastewater/forms.html>

APPENDIX S-13

Variance from Pollution Control

Hawaii Department of Health Wastewater Branch

NOTE: No variation will be granted if the water pollutant or wastes are in violation of the requirements of the Federal Water Pollution Control Act.

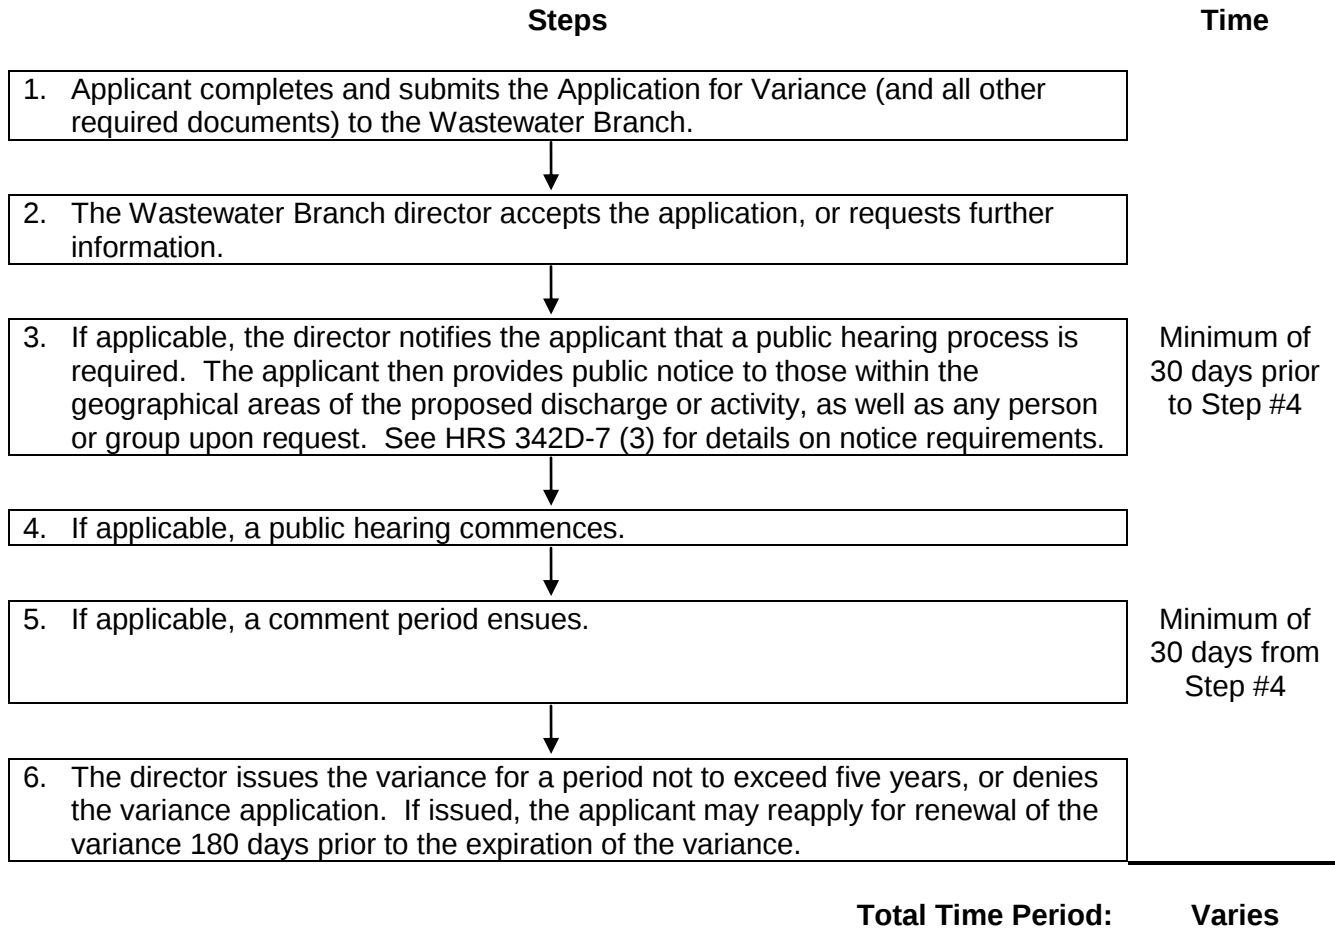

Fees	Amount	Maximum
First Time Application Fee	\$300	\$300
Renewable of a variance		\$150
Public Notice and Hearing Fees		Varies
Total Fees:	\$300 (minimum)	Varies (maximum)