

APPENDIX MAUI-13

**Fire Protection Permit
County of Maui
Department of Fire & Public Safety
Fire Prevention Bureau**

Permit Packet Includes:

1. Process Overview
2. Fire Protection Permit Application Packet & instructions

Resources:

- NFPA 24 - Underground piping
- NFPA 13 - Fire Sprinklers
- NFPA 72 - Fire Alarms


Approval or Permit Required: To install fire sprinklers, water mains for fire protection, fire hydrants, and fire alarms.

Contact Information: Department of Fire and Public Safety
Fire Prevention Bureau
780 Alua Street
Wailuku, HI 96793
Phone: 808-244-9161

Website: <http://www.co.maui.hi.us/index.aspx?nid=1458>


APPENDIX MAUI-13

**Fire Protection Permit
County of Maui
Department of Fire & Public Safety
Fire Prevention Bureau**

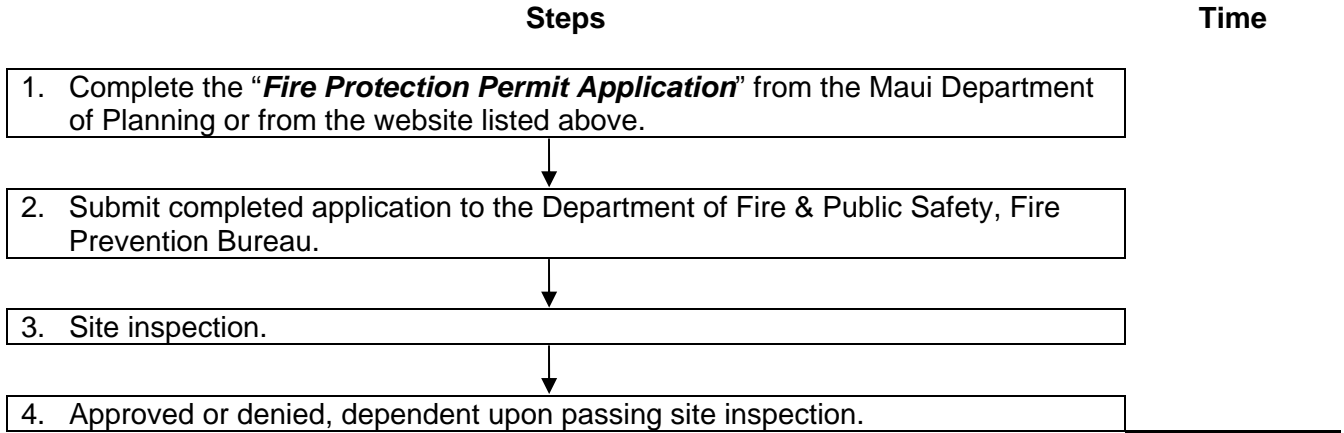

Total Time Period: 7 days

Fees	Amount	Maximum
No fees.	0	
Total Fees:	0	0



Fire Prevention Bureau
 County of Maui
 780 Alua Street
 Wailuku, Maui HI 96793
 (808)244-9161

PERMIT NO:

DATE:

TMK:

Fire Protection Permit Application

Permit Applicant Information			
TMK Owner:			
Lessee/Tenant:			
Location:		Building Permit/Subd. File No.	
Fire Protection Contractor:		C-License No.	
Phone:			

Type of Fixture	
	Quantity
Fire Sprinkler Less Than 20 Heads	
Fire Sprinkler Less Than 100 Heads	
Fire Sprinkler More Than 100 Heads	
Fire Protection Water Mains And Hydrants	
Dry Standpipe Or Fire Department Connection	
Dry Or Wet Chemical Fire Protection	
Fire Alarm System	
Fire Pumps	

Required Inspections	Approved	Disapproved
Preliminary		
Final		

Permission is hereby granted to install and operate the fixture(s) described above, and in accordance with the Fire Code of the County of Maui, provided that at any time, should the installation become, in the judgment of the Fire Chief or any of his assigns, dangerous to life, or surrounding property, the installation shall be repaired or removed immediately upon receipt of notice from the Fire Chief or his deputies. Any subsequent alterations to the above described installation shall have the written approval of the Fire Chief prior to such alteration.

 Signature of Authorized Agent

Date

 Fire Inspector

Date

Note: BEFORE BACKFILLING PIPING WITH EARTH, NOTIFY THE FIRE PREVENTION BUREAU FOR INSPECTION (244-9161).

(Rev. 3/09)