


DEPARTMENT OF ACCOUNTING AND GENERAL SERVICES

Adoption of Chapter 3-181
Hawaii Administrative Rules

SUMMARY

1. Chapter 181 of Title 3, Hawaii Administrative Rules, entitled "State Energy Conservation Code" adopting and amending the "*International Energy Conservation Code, 2006 Edition*", is repealed.

2. Chapter 181 of Title 3, Hawaii Administrative Rules, entitled "State Energy Conservation Code", amending the "*International Energy Conservation Code, 2009 Edition*" to include amendments applicable to the state, is adopted.

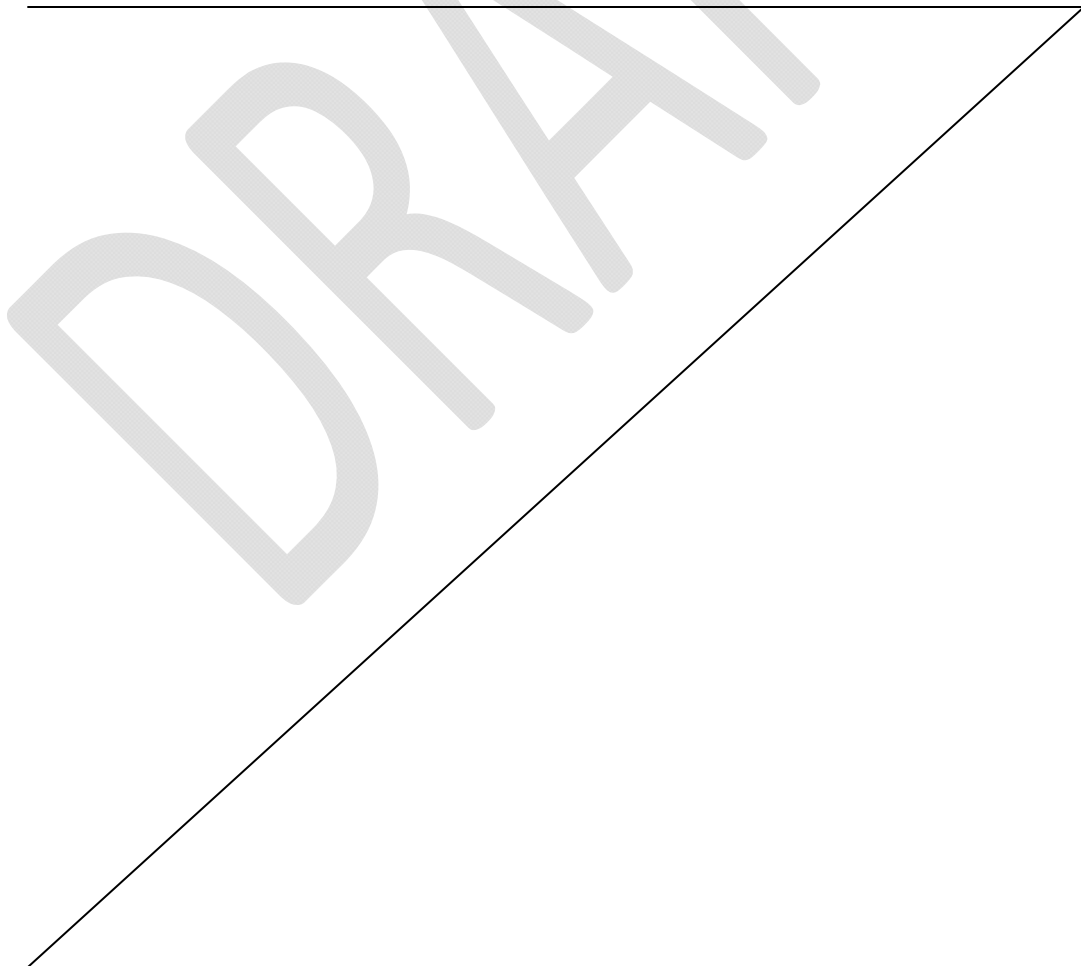

HAWAII ADMINISTRATIVE RULES

TITLE 3

DEPARTMENT OF ACCOUNTING AND GENERAL SERVICES

SUBTITLE 14

STATE BUILDING CODE COUNCIL

CHAPTER 181

STATE ENERGY CONSERVATION CODE


Subchapter 1 Rules of General Applicability

§3-181-1	Purpose
§3-181-2	Scope
§3-181-3	Definitions
§3-181-4	Adoption of the <i>International Energy Conservation Code</i>
§3-181-5	Permit authorization

Subchapter 2 Amendments to the 2009 *ICC International Energy Conservation Code*

§3-181-6	Title
§3-181-7	Low energy buildings
§3-181-8	General
§3-181-9	Inspections
§3-181-10	Certificate
§3-181-11	Insulation and fenestration requirements by component
§3-181-12	Wall insulation alternative
§3-181-13	Ceiling insulation alternatives
§3-181-14	Equivalent U-factors
§3-181-15	<u>Steel-frame ceilings, walls and floors</u>
§3-181-16	<u>U-factor</u>
§3-181-17	Glazed fenestration exemption
§3-181-18	Unconditioned building exemption
§3-181-19	Fenestration air leakage
§3-181-20	Residential pools
§3-181-21	<u>Roof assembly</u>
§3-181-22	<u>Area-weighted average - commercial</u>
§3-181-23	<u>Wall insulation reduction</u>
§3-181-24	Mechanical systems commissioning and completion requirements

<u>§3-181-25</u>	<u>Sleeping unit controls</u>
<u>§3-181-26</u>	<u>Electrical energy consumption</u> <u>(Mandatory)</u>
§3-181-27	Referenced standards

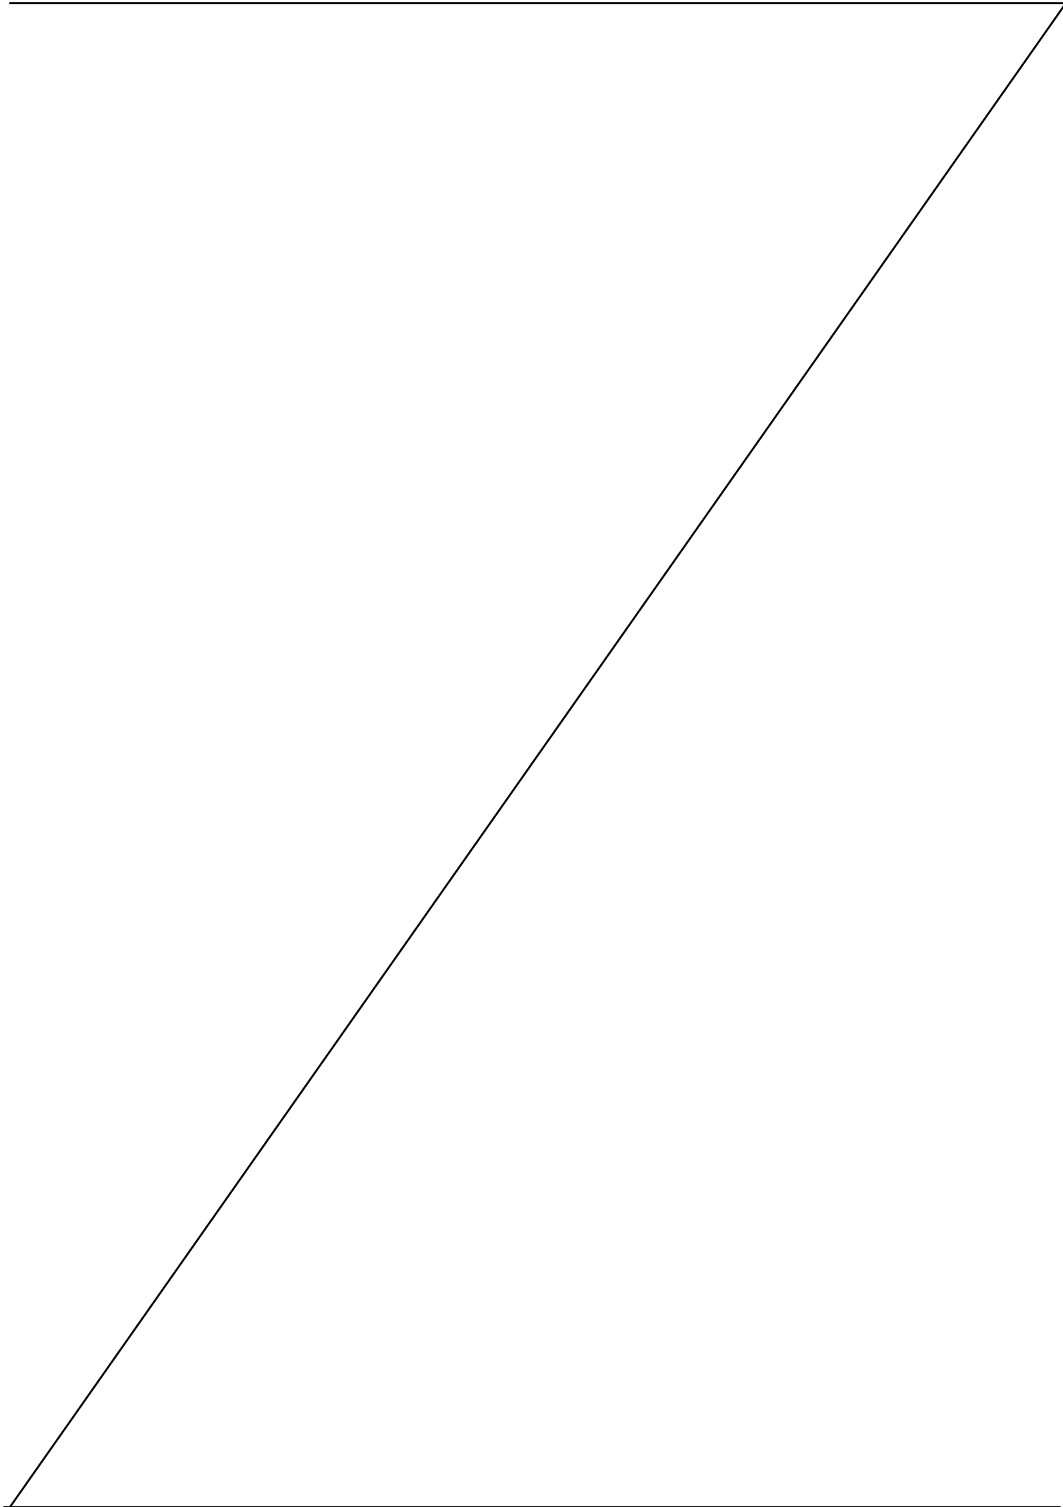

SUBCHAPTER 1

RULES OF GENERAL APPLICABILITY

§3-181-1 Purpose. The purpose of this chapter is to adopt the state energy conservation code as required by section 107-25, Hawaii Revised Statutes (HRS).
 [Eff _____] (Auth: HRS §107-29) (Imp: HRS §§107-24, 107-25)

§3-181-2 Scope. This chapter sets forth minimum requirements for the design and construction of buildings for the effective use of energy and is intended to provide flexibility to allow the use of innovative approaches and techniques to achieve the effective use of energy.
 [Eff _____] (Auth: HRS §107-29) (Imp: HRS §§107-24, 107-25)

§3-181-3 Definitions. In this chapter, unless the context otherwise requires:

“ICC” means the International Code Council.

“IECC Section” means a section of a chapter of the *International Energy Conservation Code*.

“IECC” means the ICC, *International Energy Conservation Code*, [2006] 2009 edition, as copyrighted by the International Code Council. [Eff _____]
 (Auth: HRS §107-29) (Imp: HRS §§107-24, 107-25)

§3-181-4 Adoption of the *International Energy Conservation Code*. The “*International Energy Conservation Code*, [2006] 2009 Edition” as copyrighted and published in [2006] 2009 by International Code Council, Incorporated, 500 New Jersey Avenue, 6th Floor, Washington, DC 20001, is adopted by reference and made a part of this chapter. This incorporation by reference includes all parts of the *International Energy Conservation Code* subject to the amendments hereinafter set forth. The appendices of the ICC, IECC are not adopted except as provided in this chapter. [Eff _____] (Auth: HRS §107-29)
 (Imp: HRS §§107-24, 107-25)

§3-181-5

§3-181-5 Permit authorization. Each county may, by ordinance, require that a permit be obtained from the building official for any area regulated by this chapter. [Eff _____] (Auth: HRS §107-29) (Imp: HRS §§107-24, 107-25)

SUBCHAPTER 2

AMENDMENTS TO THE 2009 ICC INTERNATIONAL ENERGY CONSERVATION CODE

§3-181-6 Title. IECC section 101.1 is amended to read as follows:

"101.1 Title. This code shall be known as the [International] Energy Conservation Code of the State of Hawaii, and shall be cited as such. It is referred to herein as "this code"." [Eff _____] (Auth: HRS §107-29) (Imp: HRS §§107-24, 107-25)

§3-181-7 Low energy buildings. IECC section 101.5.2 is amended to read as follows:

"101.5.2 Low energy buildings. The following buildings, or portions thereof, separated from the remainder of the building by building thermal envelope assemblies complying with this code shall be exempt from the building thermal envelope provisions of this code:

1. Conditioned spaces with a peak design rate of energy usage less than 3.4 Btu/h·ft² (10.7 W/m²) or 1.0 watt/ft² (10.7 W/m²) of floor area for space conditioning purposes.
2. Unconditioned spaces that are non-habitable spaces." [Eff _____] (Auth: HRS §107-29) (Imp: HRS §§107-24, 107-25)

§3-181-8 General. IECC section 103.1 is amended to read as follows:

"103.1 General. When the requirements in this code apply to a building as specified in Section 101.4, plans, specifications or other construction documents submitted for a building, electrical or plumbing permit required by the jurisdiction shall comply with this code and shall be prepared, designed, approved and observed by a design professional. The responsible design professional shall

provide on the plans a signed statement certifying that the project is in compliance with this code.

Exception: Any building, electrical or plumbing work that is not required to be prepared, designed, approved or observed by a licensed professional architect or engineer pursuant to chapter 464 Hawaii Revised Statutes." [Eff] (Auth: HRS §107-29) (Imp: HRS §§107-24, 107-25)

§3-181-9 Inspections. IECC section 104 is deleted in its entirety. [Eff] (Auth: HRS §107-29) (Imp: HRS §§107-24, 107-25)

§3-181-10 Certificate. IECC section 401.3 is amended to read as follows:

"401.3 Certificate. When required by the code official, a permanent certificate shall be posted on or in the electrical distribution panel. The certificate shall not cover or obstruct the visibility of the circuit directory label, service disconnect label or other required labels. The certificate shall be completed by the builder or registered design professional. The certificate shall list the predominant R-values of insulation installed in or on ceiling/roof, walls, foundation (slab, basement wall, crawlspace wall and/or floor) and ducts outside conditioned spaces; U-factors for fenestration and the solar heat gain coefficient (SHGC) of fenestration. Where there is more than one value for each component, the certificate shall list the value covering the largest area. The certificate shall list the types and efficiencies of heating, cooling and service water heating equipment. Where a gas-fired unvented room heater, electric furnace, or baseboard electric heater is installed in the residence, the certificate shall list "gas-fired unvented room heater," "electric furnace" or "baseboard electric heater," as appropriate. An efficiency shall not be listed for gas-fired unvented room heaters, electric furnaces or electric baseboard heaters." [Eff] (Auth: HRS §107-29) (Imp: HRS §§107-24, 107-25)

§3-181-11 Insulation and fenestration requirements by component. IECC Table 402.1.1 is amended to read as follows:

Table 402.1.1
Insulation and Fenestration Requirements by Component^a

Climate Zone	Fenestration <i>U</i> -Factor	Skylight ^b <i>U</i> -Factor	Glazed Fenestration SHGC ^{b,e}	Ceiling <i>R</i> -Value	Wood Frame Wall <i>R</i> -Value ^k	Mass Wall <i>R</i> -Value ^{l,k}	Floor <i>R</i> -Value	Basement Wall <i>R</i> -Value ^c	Slab ^d <i>R</i> -Value & Depth	Crawl Space ^c Wall <i>R</i> -Value
1	1.20	0.75	0.30	See Section [402.1.1.1] 402.1.5.2	13	3/4	NR	NR	NR	NR
2	0.75	0.75	0.30	30	13	4/6	13	0	0	0
3	0.65	0.65	0.30	30	13	5/8	19	0	0	5 / 13
4 except Marine	0.40	0.60	NR	38	13	5/10	19	10 / 13	10, 2 ft	10 / 13
5 and Marine 4	0.35	0.60	NR	38	20 or 13+5 ^h	13/17	30 ^g	10 / 13	10, 2 ft	10 / 13
6	0.35	0.60	NR	49	20 or 13+5 ^h	15/19	30 ^g	10 / 13	10, 4 ft	10 / 13
7 and 8	0.35	0.60	NR	49	21	19/21	30 ^g	10 / 13	10, 4 ft	10 / 13

For SI: 1 foot = 304.8 mm.

NR = No requirement.

- a. *R*-values are minimums. *U*-factors and SHGC are maximums. *R*-19 batts compressed into a nominal 2 × 6 framing cavity such that the *R*-value is reduced by *R*-1 or more shall be marked with the compressed batt *R*-value in addition to the full thickness *R*-value.
- b. The fenestration *U*-factor column excludes skylights. The SHGC column applies to all glazed fenestration.
- c. "15/19" means *R*-15 continuous insulated sheathing on the interior or exterior of the home or *R*-19 cavity insulation at the interior of the basement wall. "15/19" shall be permitted to be met with *R*-13 cavity insulation on the interior of the basement wall plus *R*-5 continuous insulated sheathing on the interior or exterior of the home. "10/13" means *R*-10 continuous insulated sheathing on the interior or exterior of the home or *R*-13 cavity insulation at the interior of the basement wall.
- d. *R*-5 shall be added to the required slab edge *R*-values for heated slabs. Insulation depth shall be the depth of the footing or 2 feet, whichever is less in Zones 1 through 3 for heated slabs.
- e. There are no SHGC requirements in the Marine zone.
- f. Basement wall insulation is not required in warm-humid locations as defined by Figure 301.1 and Table 301.1.
- g. Or insulation sufficient to fill the framing cavity, *R*-19 minimum.
- h. "13+5" means *R*-13 cavity insulation plus *R*-5 insulated sheathing. If structural sheathing covers 25 percent or less of the exterior, insulating sheathing is not required where structural sheathing is used. If structural sheathing covers more than 25 percent of exterior, structural sheathing shall be supplemented with insulated sheathing of at least *R*-2."
- i. The second *R*-value applies when more than half the insulation is on the interior of the mass wall.

- j. For impact rated fenestration complying with Section R301.2.1.2 of the Residential Code of the State of Hawaii or Section 1608.1.2 of the Building Code of the State of Hawaii, the maximum *U*-factor shall be 0.75 in Zone 2 and 0.65 in Zone 3.
 - k. A reduction of R-5 for interior walls or R-4 for exterior walls shall be permitted in buildings that meet one of the following criteria:
 - 1. Exterior walls are finished with a paint or surface with an average light reflectance value ≥ 0.64 (garages, trim and other non-wall components are exempt).
 - 2. High efficacy lamps in a minimum of 90 percent of permanently installed lighting fixtures.
 - 3. The building has a wall projection factor, in accordance with Equation 4-1, of not less than 0.30 for all walls that face more than 22.5 degrees from true north."
- [Eff] (Auth: HRS §107-29) (Imp: HRS §§107-24, 107-25)

§3-181-12 Wall Insulation alternative. Section 402.1.5 is added to the IECC to read as follows:

"402.1.5 Wall insulation alternative. Insulation requirements for walls in buildings are permitted to be reduced in accordance with Footnote k of Table 402.1.1, where the following conditions are met:

- 1. The building is located in climate zone 1, and
- 2. The wall projection factor is not less than 0.30 for all walls that face more than 22.5 degrees from true north.

The wall projection factor shall be determined in accordance with Equation 402-1.

(Equation 402-1)

$$WPF = A/B$$

where:

WPF = Wall projection factor (decimal)

A = Distance measured horizontally from the furthest continuous extremity of any overhang, eave, or permanently attached shading device to the vertical surface of the wall

B = Distance measured vertically from the bottom of the wall to the underside of the overhang, eave, or permanently attached shading device. The distance B does not need to extend below the bottom of the floor assembly of the lowest occupied floor level

[Eff] (Auth: HRS §107-29) (Imp: HRS §§107-24, 107-25)

S3-181-13

S3-181-13 Ceiling insulation alternatives. Sections [402.1.1.1] 402.1.6 to [402.1.1.8.1] 402.1.6.8.1 are added to the IECC to read as follows:

[402.1.1.1] 402.1.6 Ceiling insulation alternatives. [Insulation requirements for ceilings of buildings constructed in climate zone 1 shall meet one of the design options in Table 402.1.1.1.] Insulation requirements for ceilings of buildings are permitted to be modified in accordance with Sections 402.1.6.1 through 402.1.6.8.1 for buildings:

1. Located in climate zone 1, and
2. Located at elevations below 2,400-foot (731.5 m).

402.1.6.1 Design options. Ceiling insulation requirements shall meet at least one of the design options in Table 402.1.6.1. Construction documents required in accordance with Section 402.1.6.3 shall be provided for any design option utilized.

**Table [402.1.1.1] 402.1.6.1
Ceiling Insulation for Buildings in Climate Zone 1**

Design Option	Design and Construction Components				
	Roof Insulation (Section [402.1.1.4] 402.1.6.4)	Attic Ventilation (Section [402.1.1.5] 402.1.6.5)	Radiant Barrier (Section [402.1.1.6] 402.1.6.6)	Cool Roof (Section [402.1.1.7] 402.1.6.7)	Roof Heat Gain Factor below 0.05 (Section [402.1.1.8] 402.1.6.8)
1	R				
[2 ^a] 2		R	R		
[3 ^a] 3			R	R	
[4 ^a] 4					R

R = Required

[a. Design Option is not allowed at building sites above a 2,400-foot (731.5 m) elevation.]

[402.1.1.2] 402.1.6.2 Definitions. For the purpose of this section, the following terms shall be defined as follows:

GROSS AREA OF OPAQUE ROOF SURFACES. Gross area of opaque roof surfaces means the total surface of the roof assembly exposed to outside air or unconditioned spaces. The opaque roof assembly shall exclude skylight surfaces, service openings, and overhangs.

NET FREE VENT AREA. Net free vent area means the total area through which air can pass in a screen, grille face or register.

ROOF AREA. Roof area means attic floor area; or, if there is no attic, "roof area" means the horizontal rojection of roof area measured from the outside surface of the exterior walls.

~~[402.1.1.3]~~ **402.1.6.3 Construction documents.** Plans shall be submitted which indicate insulation type, thickness, and location; ventilation opening types, sizes and locations; radiant barrier location; and roof surface type as appropriate, depending on the option selected from Table ~~[402.1.1.1]~~ 402.1.6.1.

~~[402.1.1.4]~~ **402.1.6.4 Roof insulation.** Roof insulation shall be provided as follows:

1. In buildings with an attic space provide either:
 - 1.1. R-30 insulation installed above the ceiling level, or
 - 1.2. R-19 insulation installed at the roof level between the roof framing members.
2. In buildings without an attic space provide either:
 - 2.1. R-19 insulation installed at the roof level between the roof framing members, or
 - 2.2. R-15 entirely above the roof deck.

~~[402.1.1.5]~~ **402.1.6.5 Attic Ventilation.** Ventilation shall be provided by at least one of the following:

1. A baffled ridge vent installed in accordance with the manufacturer's instructions in addition to lower inlet openings to provide a total of no less than one square foot of net free vent area for each 300 square feet of roof area. No less than 30 per cent of the total vent area shall be in either the ridge vent or the lower half of the ventilated space.
2. A solar-powered exhaust fan that provides at least one cubic foot per minute of airflow for each square foot of roof area.
3. Upper and lower vents with total net free vent area of at least one square foot for each 150 square feet of roof area. At least 30 percent of the total vent area shall be in the upper half of the ventilated space and at least 30 percent of the total vent area shall be in the lower half of the ventilated space.

~~[402.1.1.6]~~ **402.1.6.6 Radiant barrier.** A radiant barrier shall have an emissivity of no greater than 0.05 as tested in accordance with ASTM E-408. The radiant barrier shall be installed with the shiny side facing down and with a minimum air gap thickness of $\frac{3}{4}$ inch below. The radiant barrier may be securely attached to the roof framing or may be laminated to the bottom of the roof sheathing.

Exception: The radiant barrier is not required within 24 inches (610 mm) of the face of the exterior wall when Table 402.1.6.1 Option 2 or 3 is selected and the unprotected portion of the roof is insulated to a value of R-19 with continuous insulation to the exterior wall.

~~[402.1.1.7]~~ **402.1.6.7 Cool roof.** A cool roof rated in compliance with the Cool Roof Rating Council, Product Rating Program Manual, shall have an infrared emittance of no ~~[more]~~ less than 0.75 when tested in accordance with ASTM E-408 and ~~[a high solar reflectance]~~ an initial reflectance of no less than 0.70 and an extended reflectance of no less than 0.55. ~~[The manufacturer's test results shall be acceptable for compliance.]~~

~~[402.1.1.8]~~ **402.1.6.8 Roof Heat Gain Factor.** The Roof Heat Gain Factor (RHGF) shall not exceed 0.05 when calculated as described in Equation ~~[402.1.1-1.]~~ 402-2.

Equation ~~[402.1.1-1]~~ 402-2

$$RHGF = U_r \times \alpha \times RB$$

Where:

RHGF = Roof Heat Gain Factor [Btu/ft²-h-°F]

U_r = overall thermal transmittance value for the gross area of opaque roof surfaces [Btu/ft²-h-°F]

α = roof surface absorptivity. Between 0.3 and 1.0 [unitless]


RB = Radiant Barrier credit. Equals 0.33 if a radiant barrier is installed and 1.00 otherwise [unitless].

Radiant barrier installation must comply with Section ~~[402.1.1.7.1]~~ 402.1.6.8.1 to qualify for Radiant Barrier credit.

~~[402.1.1.8.1]~~ **402.1.6.8.1 Radiant barrier credit.** To qualify for the radiant barrier credit (RB) described in Section ~~[402.1.1.8,]~~ 402.1.6.8, the installation of the radiant barrier must meet the following criteria:

1. The emissivity of the radiant barrier must be 0.10 or less. The manufacturer must provide test data or documentation of the emissivity as tested in accordance with ASTM E-408.
2. The radiant barrier must be securely installed in a permanent manner using one of the following installation methods:
 - 2.1. The radiant barrier shall be draped with the shiny side facing down over the top cord of the truss before the roof deck is installed. A minimum air gap of ¼ inch must be provided between the radiant barrier and the roof deck

- above at the center of the span. A minimum $\frac{3}{4}$ inch air gap must also be provided between the radiant barrier and the ceiling or insulation below.
- 2.2. The radiant barrier shall be stretched with the shiny side facing down between the top cords of the truss and stapled or otherwise secured at each side. A minimum air space of $\frac{3}{4}$ inch above and below is required.
 - 2.3. For attic installations only, the radiant barrier shall be stapled or otherwise secured to the bottom surface of the top cord of the truss and draped below with the shiny side facing down. A minimum air space of $\frac{3}{4}$ inch above and below is required.
 - 2.4. For open beam ceiling construction only, the radiant barrier shall be laid on top of the roof deck with the shiny side facing up and a minimum $\frac{3}{4}$ inch air gap between the radiant barrier and the roofing material above. The roof slope must be greater than or equal to 14° from horizontal.
3. At least one square foot of free area for ventilation shall be provided per 150 square feet of attic floor area, or in the case of vaulted or open-beam ceilings, per 150 square feet of ceiling area. In vaulted or open beam ceilings, the air space shall be vented with vent area approximately evenly distributed between the top and the bottom. In vaulted ceilings, vents shall be provided for each air space between rafters."
- [Eff _____] (Auth: HRS §107-29) (Imp: HRS §§107-24, 107-25)

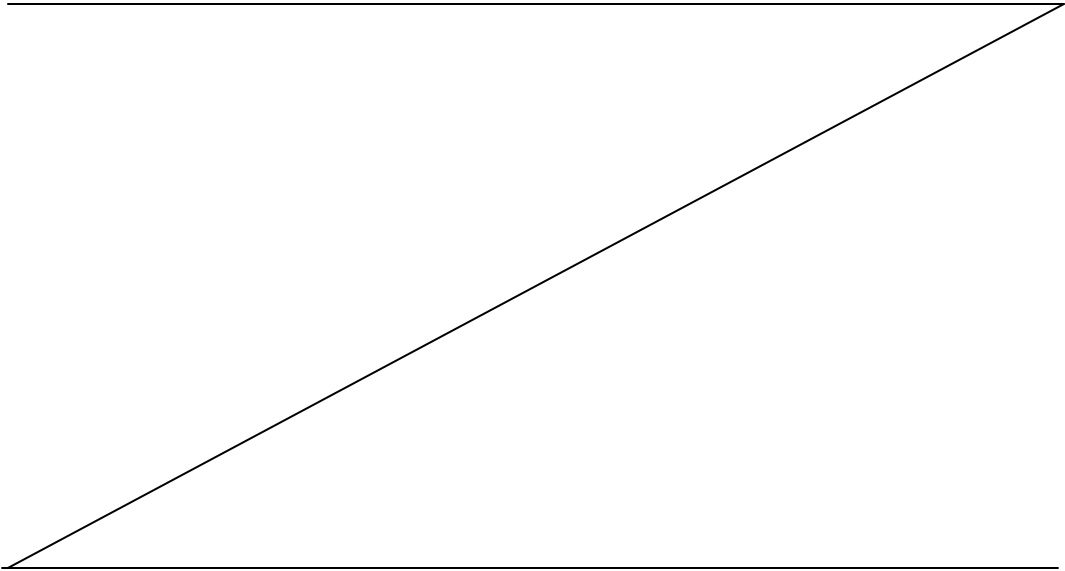

§3-181-14

§3-181-14 Equivalent U-factors. IECC Table 402.1.3 is amended to read as follows:

**“Table 402.1.3
Equivalent U-Factors^a**

Climate Zone	Fenestration U-Factor	Skylight U-Factor	Ceiling U-Factor	Frame Wall U-Factor	Mass Wall U-Factor ^b	Floor U-Factor	Basement Wall U-Factor	Crawl Space Wall U-Factor ^c
1	1.2	0.75	0.035	0.082	0.197	NR	NR	NR
2	0.65	0.75	0.035	0.082	0.165	0.064	0.360	0.477
3	0.50	0.65	0.035	0.082	0.141	0.047	0.091 ^c	0.136
4 except Marine	0.35	0.60	0.030	0.082	0.141	0.047	0.059	0.065
5 and Marine 4	0.35	0.60	0.030	0.057	0.082	0.033	0.059	0.065
6	0.35	0.60	0.026	0.057	0.060	0.033	0.050	0.065
7 and 8	0.35	0.60	0.026	0.057	0.057	0.028	0.050	0.065

NR = No requirement.

- a. Nonfenestration U-factors shall be obtained from measurement, calculation or an approved source.
- b. When more than half the insulation is on the interior, the mass wall U-factors shall be a maximum of 0.17 in Zone 1, 0.14 in Zone 2, 0.12 in Zone 3, 0.10 in Zone 4 except Marine, and the same as the frame wall U-factor in Marine Zone 4 and Zones 5 through 8.
- c. Basement wall U-factor of 0.360 in warm-humid locations as defined by Figure 301.1 and Table 301.1.” [Eff _____] (Auth: HRS §107-29) (Imp: HRS §§107-24, 107-25)

§3-181-15 Steel-frame ceilings, walls and floors.

IECC section 402.2.5 is amended to read as follows:

“402.2.5 Steel-frame ceilings, walls, and floors.

Steel-frame ceilings, walls and floors shall meet the insulation requirements of Table 402.2.5 or shall meet the U-factor requirements in Table 402.1.3. The calculation of the U-factor for a steel-frame envelope assembly shall use a series-parallel path calculation method.

Exception: Buildings located at elevations below 2,400 feet (731.5 m) do not need to comply with the continuous R-value requirement where one of the following apply:

1. In Climate Zones 1 and 2, the continuous insulation requirements in Table 402.2.5 shall be permitted to be reduced to R-3 for steel frame

§3-181-18

requirements in Section 402.1.1." [Eff]
(Auth: HRS §107-29) (Imp: HRS §§107-24, 107-25)

§3-181-18 Unconditioned building exemption. Section 402.4.1.1 is added to the IECC to read as follows:

"402.4.1.1 Unconditioned building exemption. Unconditioned residential buildings are exempt from compliance with Section 402.4. The free-vent fenestration area of unconditioned buildings shall be no less than 14 per cent of the floor area. All interior doors shall be capable of being secured in the open position and ceiling fan stub-ins shall be provided to living areas and bedrooms." [Eff] (Auth: HRS §107-29)
(Imp: HRS §§107-24, 107-25)

§3-181-19 Fenestration air leakage. IECC section 402.4.4 is amended to read as follows:

"402.4.4 Fenestration air leakage. Windows, skylights and sliding glass doors shall have an air infiltration rate of no more than 0.3 cfm per square foot (1.5 L/s/m²), and swinging doors no more than 0.5 cfm per square foot (2.6 L/s/m²), when tested according to NFRC 400 or AAMA/WDMA/CSA 101/I.S.2/A440 by an accredited, independent laboratory and listed and labeled by the manufacturer.

Exceptions:

1. Site-built windows, skylights and doors.
 2. Jalousie windows shall not exceed 1.2 cfm per square foot (6.1 L/s/m²)."
- [Eff]
(Auth: HRS §107-29) (Imp: HRS §§107-24, 107-25)

§3-181-20 Residential pools. IECC section 403.9 is amended to read as follows:

"403.9 Residential pools. Residential pools shall be provided with energy-conserving measures in accordance with Sections 403.9.1 through 403.9.3.

403.9.1 Pool heaters. All pool heaters shall be equipped with a readily accessible on-off switch to allow shutting off the heater without adjusting the thermostat setting. [~~Pool heaters fired by natural gas~~] Gas-fired pool heaters shall not have continuously burning pilot lights.

403.9.2 Time switches. Time switches that can automatically turn off and on heaters and pumps according

to a preset schedule shall be installed on swimming pool heaters and pumps.

Exceptions:

1. Where public health standards require 24-hour pump operation.
2. Where pumps are required to operate solar- and waste-heat-recovery pool heating systems.

403.9.3 Pool covers. Heated pools shall be equipped with a vapor retardant pool cover on or at the water surface. Pools heated to more than 90°F (32°C) shall have a pool cover with a minimum insulation value of R-12.

Exception: Pools deriving over 60 percent of the energy for heating from site-recovered energy or solar energy source." [Eff]
(Auth: HRS §107-29) (Imp: HRS §§107-24, 107-25)

§3-181-21 Roof assembly. IECC section 502.2.1 is amended to read as follows:

"502.2.1 Roof assembly. The minimum thermal resistance (*R*-value) of the insulating material installed either between the roof framing or continuously on the roof assembly shall be as specified in Table 502.2(1), based on construction materials used in the roof assembly.

Exception: Buildings located at elevations below 2,400 feet (731.5 m) do not need to comply where one of the following apply:

1. Continuously insulated roof assemblies where the thickness of insulation varies 1 inch (25 mm) or less and where the area-weighted *U*-factor is equivalent to the same assembly with the *R*-value specified in Table 502.2(1).
2. Roofs in compliance with the Cool Roof Rating Council, Product Rating Program Manual, meeting initial reflectance values of 0.70 and extended reflectance values of 0.55.

Insulation installed on a suspended ceiling with removable ceiling tiles shall not be considered part of the minimum thermal resistance of the roof insulation."

[Eff] (Auth: HRS §107-29) (Imp: HRS §§107-24, 107-25)

§3-181-22 Area-weighted average - commercial. Section 502.3.3 is added to the IECC to read as follows:

§3-181-23

"502.3.3 Area-weighted average - commercial. In commercial buildings, an area-weighted average of fenestration products shall be permitted to satisfy SHGC requirements." [Eff _____] (Auth: HRS §107-29) (Imp: HRS §§107-24, 107-25)

§3-181-23 Wall insulation reduction. Section 502.2.3.1 is added to the IECC to read as follows:

"502.2.3.1 Wall insulation reduction. A reduction of R-5 for interior walls or R-4 for exterior walls shall be permitted in buildings that meet the following criteria:

1. The building is located at an elevation below 2,400-foot (731.5 m) above sea level,
2. The building is located in climate zone 1, and
3. The building has a wall projection factor, in accordance with Equation 402-1, of not less than 0.30 for all walls that face more than 22.5 degrees from true north." [Eff _____] (Auth: HRS §107-29) (Imp: HRS §§107-24, 107-25)

§3-181-24 Mechanical systems commissioning and completion requirements. IECC sections 503.2.9 to 503.2.9.3 are retitled and amended to read as follows:

"503.2.9 Mechanical systems commissioning and completion requirements. Prior to the issuance of a certificate of occupancy, the design professional shall provide a written statement of system completion in accordance with Sections 503.2.9.1 through 503.2.9.3.

503.2.9.1 System commissioning. Commissioning is a process that verifies and documents that the selected building systems have been designed, installed, and function according to the owner's project requirements and construction documents. Drawing notes shall require commissioning and completion requirements in accordance with this section. Drawing notes may refer to specifications for further requirements. Copies of all documentation shall be given to the owner.

503.2.9.2 Commissioning plan. A commissioning plan shall include as a minimum the following items:

1. A detailed explanation of the original owner's project requirements,
2. A narrative describing the activities that will be accomplished during each phase of commissioning,

- including guidance on who accomplishes the activities and how they are completed,
3. Equipment and systems to be tested, including the extent of tests,
 4. Functions to be tested (for example calibration, economizer control, etc.),
 5. Conditions under which the test shall be performed (for example winter and summer design conditions, full outside air, etc.), and
 6. Measurable criteria for acceptable performance.

503.2.9.3 Systems adjusting and balancing. All HVAC systems shall be balanced in accordance with generally accepted engineering standards. Air and water flow rates shall be measured and adjusted to deliver final flow rates within 10 per cent of design rates. Test and balance activities shall include as a minimum the following items:

1. Air systems balancing: Each supply air outlet and zone terminal device shall be equipped with means for air balancing in accordance with the requirements of Chapter 6 of the International Mechanical Code. Discharge dampers are prohibited on constant volume fans and variable volume fans with motors 10 hp (18.6 kW) and larger. Air systems shall be balanced in a manner to first minimize throttling losses then, for fans with system power of greater than 1 hp, fan speed shall be adjusted to meet design flow conditions.

Exception: Fan with fan motors of 1 hp or less.

2. Hydronic systems balancing: Individual hydronic heating and cooling coils shall be equipped with means for balancing and pressure test connections. Hydronic systems shall be proportionately balanced in a manner to first minimize throttling losses, then the pump impeller shall be trimmed or pump speed shall be adjusted to meet design flow conditions. Each hydronic system shall have either the ability to measure pressure across the pump, or test ports at each side of each pump.

Exceptions:

1. Pumps with pump motors of 5 hp or less.
2. When throttling results in no greater than 5% of the nameplate horsepower draw above that required if the impeller were trimmed." [Eff]
(Auth: HRS §107-29) (Imp: HRS §§107-24, 107-25)

§3-181-25

§3-181-25 Sleeping unit controls. IECC section 505.2.3 is amended to read as follows:

"505.2.3 Sleeping unit controls. [~~Sleeping units in hotels, motels, boarding houses or similar buildings shall have at least one master switch at the main entry door that controls all permanently wired luminaires and switched receptacles, except those in the bathroom(s). Suites shall have a control meeting these requirements at the entry to each room or at the primary entry to the suite.~~] Sleeping units in Group R-1 occupancies shall be equipped with a method of adjusting thermostat set points and turning off all permanently installed light fixtures and all outlets powering portable light fixtures and entertainment devices when the unit is unoccupied.

Exception: Bathroom night lights, not exceeding three watts.

Each sleeping unit in Group R-1 occupancies shall be equipped with one or more of the following devices or systems:

1. A master switch at the main entry door activated by a room card that must be inserted upon entry,
2. A sensor capable of detecting when the room is occupied, or
3. An electronic control system capable of detecting when the room is occupied.

Operable doors leading from a conditioned space to a balcony or patio in sleeping units of Group R-1 occupancies shall be provided with interlock controls to disable heating and cooling of the space while the door is open."

[Eff _____] (Auth: HRS §107-29) (Imp: HRS §§107-24, 107-25)


§3-181-26 Electrical energy consumption. (Mandatory). IECC section 505.7 is amended to read as follows:

"505.7 Electrical energy consumption. (Mandatory). [~~In buildings having individual dwelling units, provisions shall be made to determine the electrical energy consumed by each tenant by separately metering individual dwelling units.~~] In new buildings with tenants, metering shall be collected for the entire building and individually for each tenant occupying 1,000 square feet (93 m²) or more. Tenants shall have access to all data collected for their space. A tenant is defined as "one who rents or leases from a

landlord." [Eff] (Auth: HRS §107-29) (Imp: HRS §§107-24, 107-25)

§3-181-27 Referenced standards. The following standard is added to IECC chapter 6 - Referenced Standards to read as follows:

"ASTM E 408-2008, Standard Test Methods for Total Normal Emittance of Surfaces Using Inspection Meter Techniques.....[~~402.1.1.6, 402.1.1.7, 402.1.1.8.1~~] 402.1.6.6, 402.1.6.7, 402.1.6.8.1" [Eff] (Auth: HRS §107-29) (Imp: HRS §§107-24, 107-25)

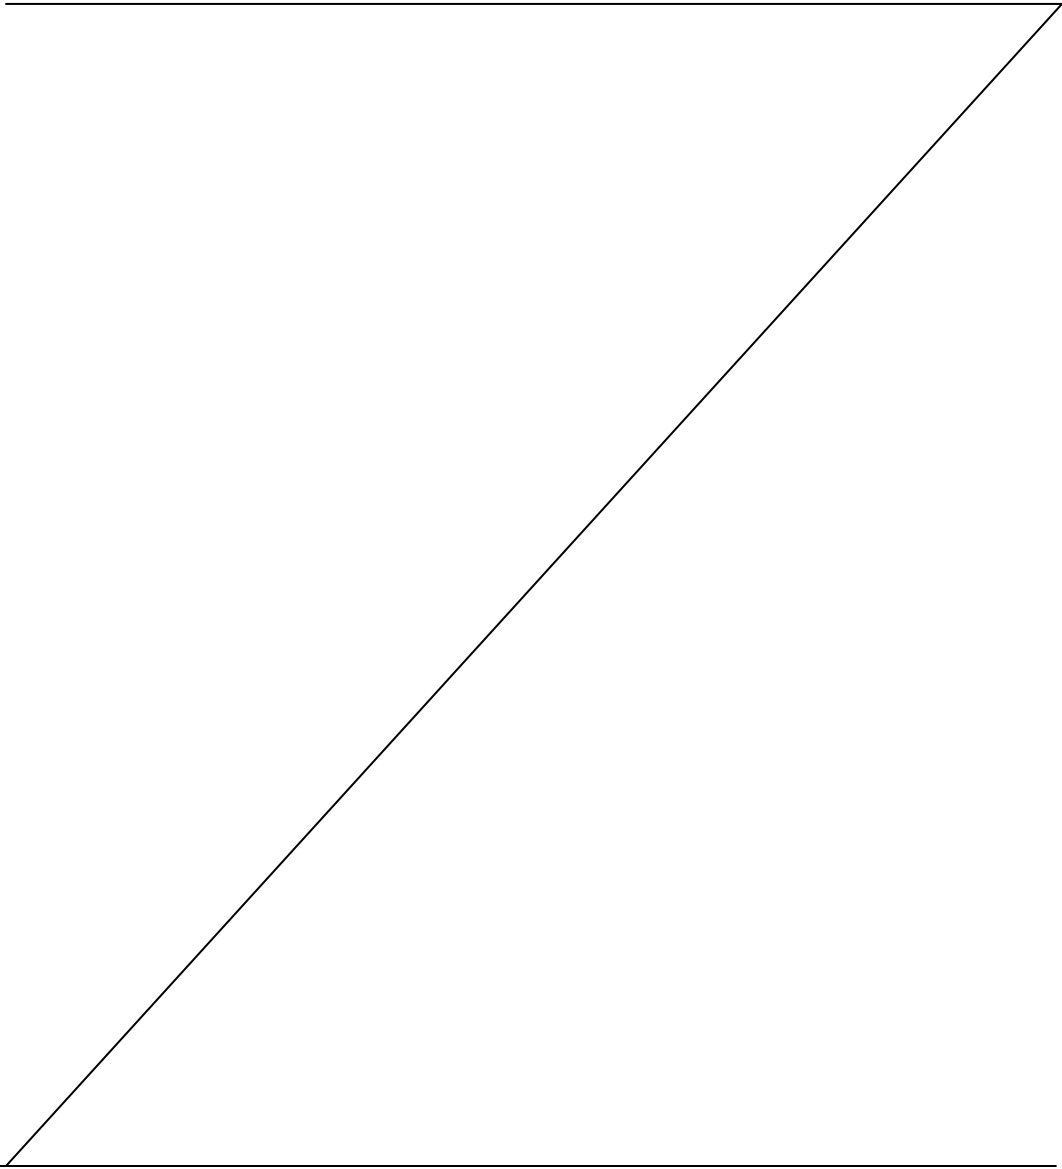

DEPARTMENT OF ACCOUNTING AND GENERAL SERVICES

Chapter 3-181, Hawaii Administrative Rules, on the Summary Page dated _____, was adopted on _____, following a public hearing held on _____, after public notice was given in the Honolulu Star-Advertiser on _____.

The adoption of chapter 3-181 shall take effect ten days after filing with the Office of the Lieutenant Governor.

BRUCE COPPA
State Comptroller and
Chairperson, State Building Code
Council

APPROVED:

NEIL ABERCROMBIE
GOVERNOR
STATE OF HAWAII

Dated: _____

APPROVED AS TO FORM:

Deputy Attorney General

Filed