

## APPENDIX S-13

### Variance from Pollution Control

#### Hawaii Department of Health Wastewater Branch

---

**Permit Packet Includes:**

1. Process Overview
2. Application for Variance (Effective December 9, 2004)
3. Hawaii Revised Statutes 342D-7
4. Hawaii Administrative Rules 11-62

**Approval or Permit Required:** To discharge water pollutant in excess of applicable standards according to Hawaii Administrative Rules 11-62.

**Contact Information:** 919 Ala Moana Blvd, Room 309  
Honolulu, HI 96814-4920  
Phone: 808-586-4294  
Fax: 808-586-4300

**Website:** <http://hawaii.gov/health/environmental/water/wastewater/forms.html>


---

## APPENDIX S-13

### Variance from Pollution Control

#### Hawaii Department of Health Wastewater Branch

**NOTE:** No variation will be granted if the water pollutant or wastes are in violation of the requirements of the Federal Water Pollution Control Act.

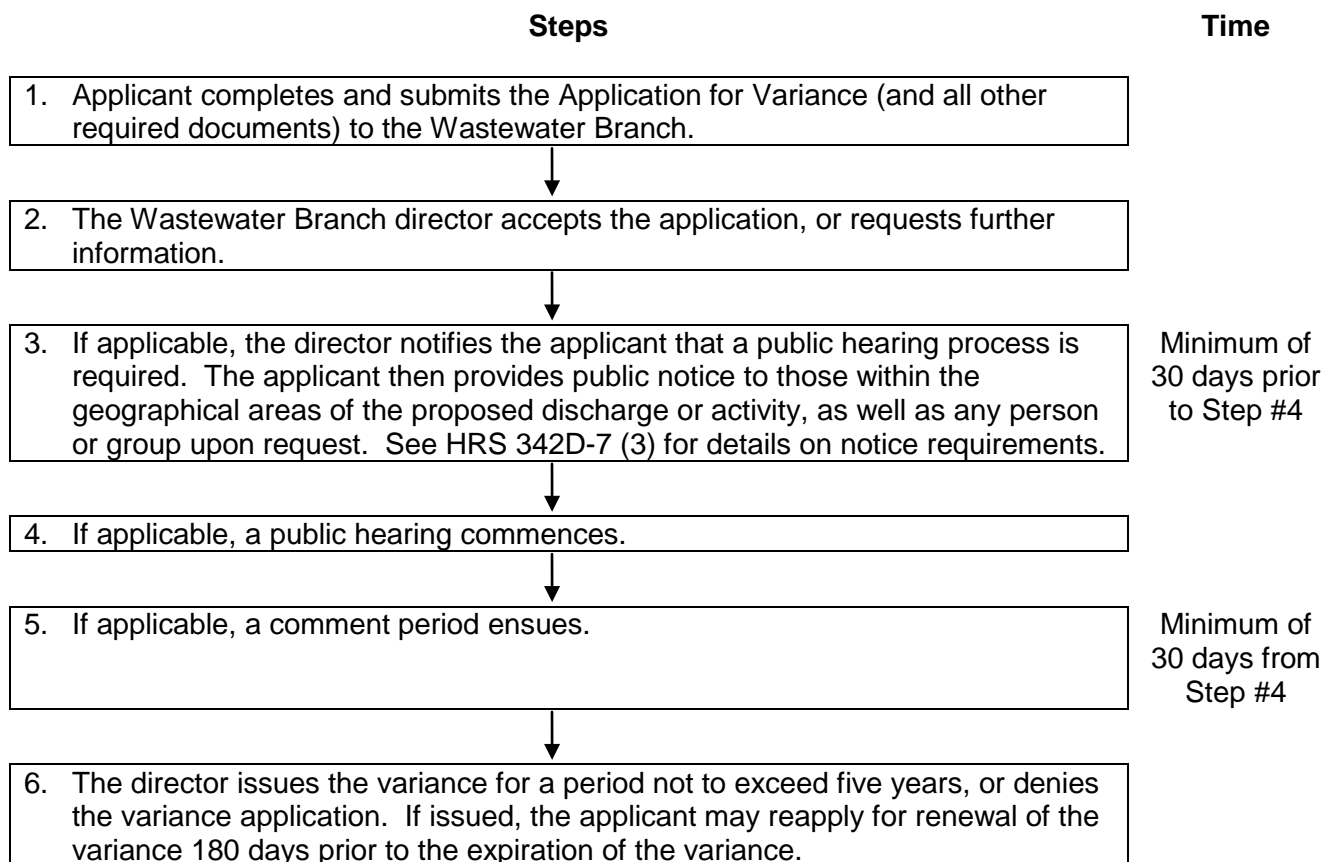

**Total Time Period:      Varies**

Fees	Amount	Maximum
First Time Application Fee	\$300	\$300
Renewable of a variance		\$150
Public Notice and Hearing Fees		Varies
<b>Total Fees:</b>	<b>\$300 (minimum)</b>	<b>Varies (maximum)</b>